

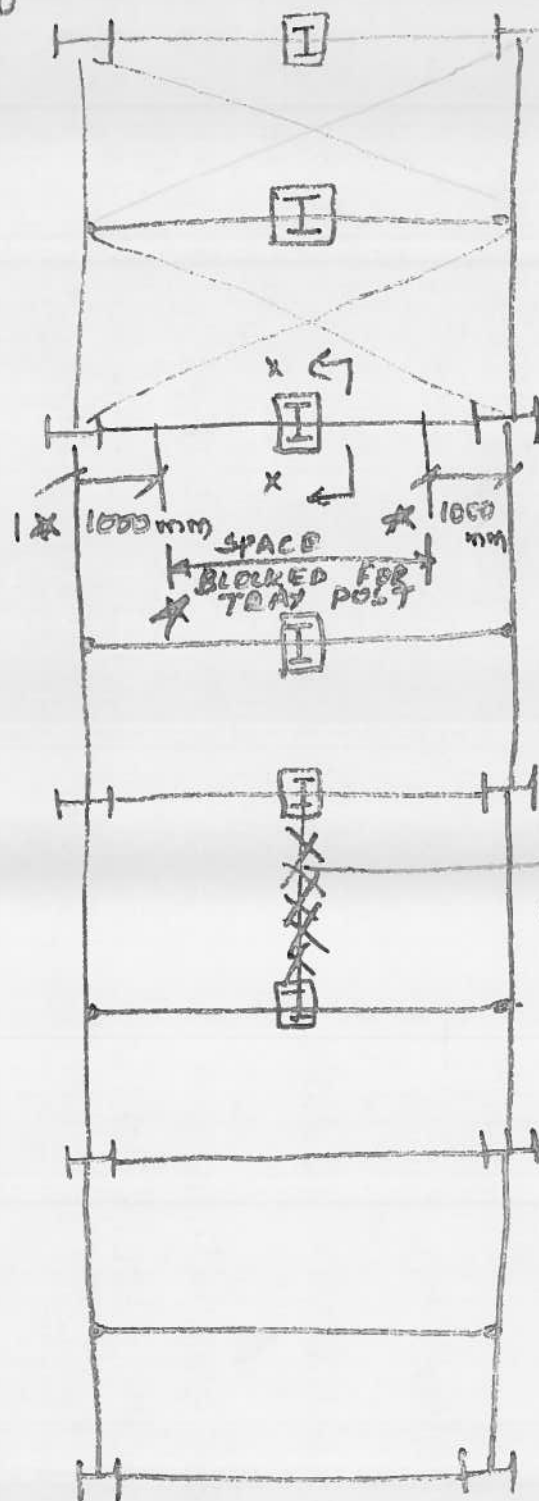


- 1* 1000mm space on either side considered for bracing connection, and space in between is blocked for tray supporting member.
- 2* Longitudinal tie members b/n posts not allowed

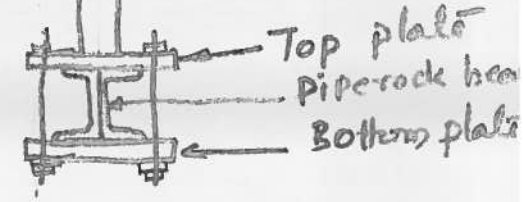

3000
C/L of cable tray.
Support.

Plan bracing to be followed as shown.

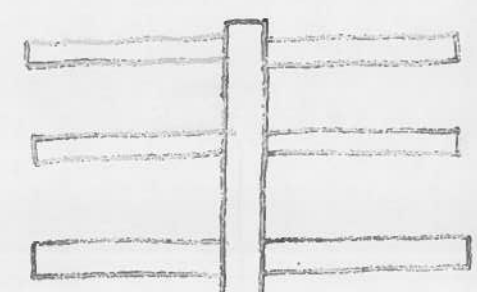

2* NO longitudinal Tie member

SEC X-X
Typical cable tray post arrangement